CyberPower®

THE POWER TO CONTROL THE POWER

PARAGON SERIES

USER MANUAL

OL1-10KVA UPS

Uninterruptible Power Supply

Contents

1. Safety and EMC Instructions 1
1.1 Installation 1
1.2 Operation 2
1.3 Maintenance, Servicing and Faults 2
1.4 Transport 2
1.5 Storage 3
1.6 Standars 4
2. Description of Commonly Used Notations 5
3. Introduction -OL1000TEXL/OL1000EXL-M/OL2000TEXL/OL2000EXL-M/ OL3000TEXL/OL3000EXL-M 6
4. System Description 7
5. Connection and Operation for OL1000TEXL/OL1000EXL-M/OL2000TEXL /OL2000EXL-M/ OL3000TEXL/OL3000EXL-M 9
6. Trouble Shooting 13
7. Maintenance 14
7.1 Operation 14
7.2 Storage 14
8. Technical data 15
8.1 Electrical Specifications 15
8.2 Operating Environment 15
8.3 Typical Battery Back-up Time 15
8.4 Dimensions and Weights 16
9. Product Specification and Performance- OL6000TEXL/OL6000EXL-M/OL10000TEXL/OL10000EXL-M 17
9.1 Gerenal Specification 17
9.2 Electrical Performance 17
9.2 Operating Environment 18
10. Installation 19
10.1 Unpacking and Inspection 19
10.2 Input and Output Power Cords and Protective Earth Ground Installation 19

10.3 Operating Procedure for Connecting the Extended Backup Time Model UPS with the External Battery 21

10.4 Parallel Operation..... 23

11. Operation and Maintenance 29

12. Battery Maintenance 29

13. Notes for Battery Disposal and Battery Replacement 30

14. Trouble Shooting..... 31

15. Operating Mode for all Models..... 33

16. Communication Port..... 36

17. Software for All Models 37

Appendix 1－Display Panel（for OL6000TEXL/OL6000EXL-M/ OL10000TEXL/OL10000EXL-M） 38

Appendix 2－The Corresponding Form of The LED Display for OL6000TEXL/ OL6000EXL-M/OL10000TEXL/OL10000EXL-M..... 39

Appendix 3－Back Panel..... 41

1. Safety and EMC instructions

Please read carefully the following user manual and the safety instructions before installing the unit or using the unit!

1.1 Installation

★ Condensation may occur if the UPS is moved directly from a cold to a warm environment. The UPS must be absolutely dry before being installed. Please allow an acclimatization time of at least two hours.

★ Do not install the UPS near water or in damp environment.

★ Do not install the UPS where it would be exposed to direct sunlight or near heat.

★ Do not block ventilation openings in the UPS's housing.

★ Do not connect appliances or items of equipment which would overload the UPS (e.g. laser printers, etc) to the UPS outlet sockets.

★ Place cables in such a way that no one can step on or trip over them.

1.1.1 Installation for OL1000TEXL/OL1000EXL-M/OL2000TEXL/ OL2000EXL-M/OL3000TEXL/OL3000EXL-M

★ Socket-outlets and socket of batteries are earthed by the input power cord, please insert the power cord into mains socket before using of UPS.

★ Connect the UPS only to an earthed shockproof socket outlet.

★ The building wiring socket outlet (shockproof socket outlet) must be easily accessible to close to the UPS.

★ This is operator installable.

1.1.2 Installation for OL6000TEXL/OL6000EXL-M/OL10000TEXL/ OL10000EXL-M

★ UPS has provided earthed terminal, in the final installed system configuration, equipotential earth bonding to the external UPS battery cabinets.

★ An integral single emergency switching device which prevents further supply to the load by the UPS in any mode of operation should be provided in the building wiring installation.

★ An appropriate disconnect device as short-circuit backup protection should be provided in the building wiring installation.

★ For three-phase equipment connection to an IT power system, a four-pole device which disconnect all phase conductors and the neutral conductor should be provided in the building wiring installation.

★ This is permanently connected equipment , it must be installed by qualified maintenance personnel.

★ Earth connection essential before connecting to the building wiring terminal.

1.2 Operation

★ Do not disconnect the mains cable on the UPS or the building wiring socket (grounded shockproof socket) during operation as this would remove the ground to the UPS and of all connected loads.

★ The UPS output socket or output terminal block may be electrically lived even if the UPS system is not connected to the building wiring terminal.

★ In order to fully disconnect the UPS, first press the Standby button, then disconnect the mains lead.

★ Ensure that no liquid or other foreign objects can enter the UPS.

★ The UPS can be operated by any individuals with no previous experience.

1.3 Maintenance, servicing and faults

★ The UPS operates with hazardous voltages. Repairs may be carried out only by qualified maintenance personnel.

★ Caution - risk of electric shock. Even after the unit is disconnected from the mains power supply (building wiring socket), components inside

the UPS are still connected to the battery which are potentially dangerous.

★ Before carrying out any kind of service and/or maintenance, disconnect the batteries. Verify that no current is present and no hazardous voltage exists in the capacitor or BUS capacitor terminals.

★ Batteries must be replaced only by qualified personnel.

★ Caution - risk of electric shock. The battery circuit is not isolated from the input voltage. Hazardous voltages may occur between the battery terminals and the ground. Verify that no voltage is present before servicing!

★ Batteries have a high short-circuit current and pose a risk of shock Take all precautionary measures specified below and any other measures necessary when working with batteries:

- remove all jewellery, wristwatches, rings and other metal objects
- use only tools with insulated grips and handles.

★ When changing batteries, replace with the same quantity and the same type of batteries.

★ Do not attempt to dispose of batteries by burning them. It could cause explosion.

★ Do not open or destroy batteries. effluent electrolyte can cause injury to the skin and eyes. It may be toxic.

★ Please replace the fuse only by a fuse of the same type and of the same amperage in order to avoid fire hazards.

★ Do not dismantle the UPS, except the qualified maintenance personnel.

1.4 Transport

★ Please transport the UPS only in the original packaging (to protect against shock and impact).

1.5 Storage

★ The UPS must be stockpiled in the room where it is ventilated and dry.

1.6 Standards

■ For OL1000TEXL/OL1000EXL-M/OL2000TEXL/OL2000EXL-M/ OL3000TEXL/OL3000EXL-M

*** Safety**	
IEC/EN 62040-1-1	
*** EMI**	
Conducted Emission.....:IEC/EN 62040-2	Category C1
Radiated Emission.....:IEC/EN 62040-2	Category C1
Harmonic Current.....:IEC/EN 61000-3-2	
Voltage Fluctuation and Flicker.....:IEC/EN 61000-3-3	
***EMS**	
ESD.....:IEC/EN 61000-4-2	Level 4
RS.....:IEC/EN 61000-4-3	Level 3
EFT.....:IEC/EN 61000-4-4	Level 4
SURGE.....:IEC/EN 61000-4-5	Level 4
Low Frequency Signals.....:IEC/EN 61000-2-2	

■ For OL6000TEXL/OL6000EXL-M/OL10000TEXL/OL10000EXL-M

*** Safety**	
IEC/EN 62040-1-1	
*** EMI**	
Conducted Emission.....:IEC/EN 62040-2	Category C3
Radiated Emission.....:IEC/EN 62040-2	Category C3
***EMS**	
ESD.....:IEC/EN 61000-4-2	Level 4
RS.....:IEC/EN 61000-4-3	Level 3
EFT.....:IEC/EN 61000-4-4	Level 4
SURGE.....:IEC/EN 61000-4-5	Level 4
Low Frequency Signals.....:IEC/EN 61000-2-2	
Warning: This is a product for commercial and industrial application in the second environment-installation restrictions or additional measures may be needed to prevent disturbances.	

2. Description of commonly used notations

Some or all of the following symbols may be used in this manual. It is advisable to familiarize yourself with them and understand their meaning.

Symbol and Explanation	
Symbol	**Explanation**
	Alert! Pay special attention
	Caution! high voltage
	Turn on the UPS
	Turn off the UPS
	Idle or shut down the UPS
	Altermating current source(AC)
	Direct current source(DC)
	Protective ground
	Alarm silence
	Overload indication
	Battery
	Recycle
	Do not dispose with ordinary trash

3. Introduction – OL1000TEXL/OL1000EXL-M/ OL2000TEXL/OL2000EXL-M/ OL3000TEXL/OL3000EXL-M

The On-Line-Series is an uninterruptible power supply incorporating double convertion technology. It provides failsafe power to the connected equipment.

The double convertion design eliminates all power disturbances. A rectifier converts the alternating current from the socket to direct current. This direct current charges the batteries and powers the inverter. The inverter generates a sinusoidal AC voltage to power the loads.

In the event of power failure, the maintenance-free batteries power the inverter.

This manual covers the UPS units listed below.

Model No.	Type	Model No.	Type
OL1000TEXL	Standard	OL1000EXL-M	Extended backup time
OL2000TEXL		OL2000EXL-M	
OL3000TEXL		OL3000EXL-M	

4. System Description

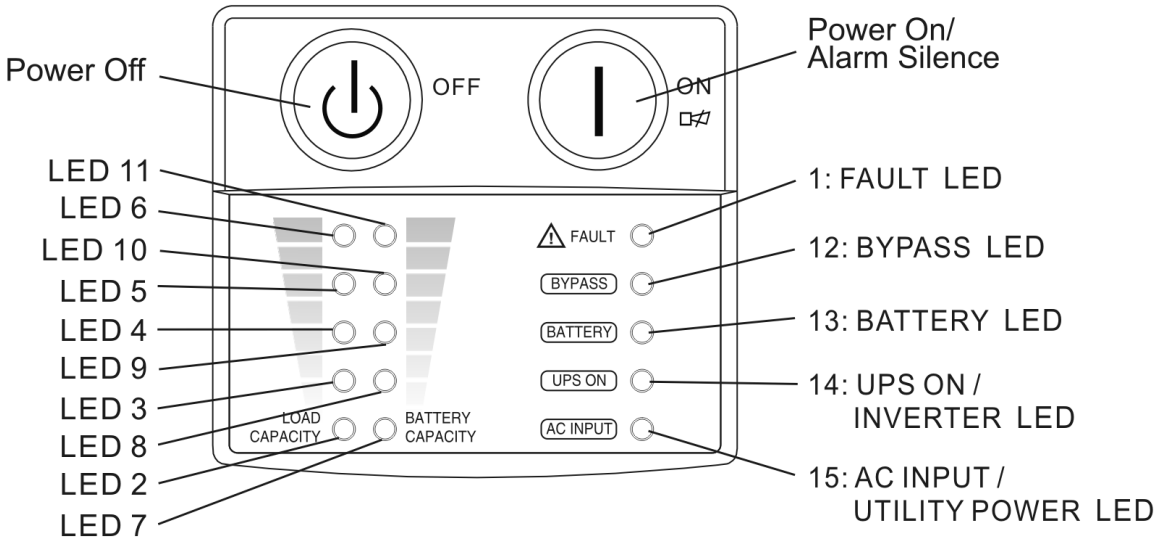

Figure 1: Display Panel

Switch	Function
ON - Switch	Turn on UPS system: By pressing the ON-Switch “I” the UPS system is turned on. Deactivate audible: By pressing this switch an acoustic alarm can be deactivated.
OFF-Switch	Utility power is normal, the UPS system switches to Standby mode by pressing OFF-Switch “⏻“. It is then switched to Bypass and the inverter is off. At this time, the output sockets are supplied with voltage via the bypass if the utility power is available.

Display	Function
1: FAULT LED	The red fault LED lights up and an acoustic warning signal is issued continuously when the UPS system is in fault condition. Press the Standby switch in order to turn off the warning tone.
12: BYPASS LED	The orange-coloured BYPASS LED lights up when the UPS system is supplying voltage provided by the utility power via the bypass.

13: **BATTERY LED**	The green-coloured BATTERY-LED lights up when the utility power has failed and the inverter is being powered by the batteries.
14: **UPS ON LED**	The green-coloured UPS ON LED lights up if the UPS system is supplying voltage provided by the utility power via the inverter.
15: **AC INPUT LED**	The green AC INPUT LED lights up if utility voltage is applied to the UPS input. AC INPUT LED blinks when the phase and neutral conductor have been reversed at the input of the UPS system. If AC INPUT LED and BATTERY-LED light up, the utility power supply is out of tolerance.

Display	Function
LOAD and BATTERY CAPACITY LEDs	2-6 LEDs show the load of the UPS system (+/-5% Tolerance): LED 2: 0-30% LED 3: 31%-50% LED 4: 51%-70% LED 5: 71%-95% LED 6: 96%-105% 7-11 LEDs show the load of the batteries (+/-5% Tolerance): LED 7: 0-25 % LED 8: 26%-50% LED 9: 51%-75% LED 10: 76%-95% LED 11: 96%-100%

5. Connection and Operation for OL1000TEXL/ OL1000EXL-M/OL2000TEXL/OL2000EXL-M/ OL3000TEXL/OL3000EXL-M

The system must be installed and wired only by licensed electricians in accordance with applicable electrical regulations!

When installing the electrical wiring, please note the nominal amperage of your incoming feeder.

5.1 Inspection:

Inspect the packaging carton and its contents for damage. Please inform the freight carrier immediately if you find signs of damage.

Please keep the packaging in a safe place for future use.

Note: *Please ensure that the incoming feeder is isolated and secured to prevent it from being switched back on again.*

5.2 Connection:

5.2.1 UPS Input Connection

If the UPS is connected via the power cord, please use a proper wired and grounded socket. Pay attention to the capacity of the socket: over 10A for OL1000TEXL, OL1000EXL-M & OL2000TEXL, over 16A for OL2000EXL-M& OL3000TEXL/OL3000EXL-M.

5.2.2 UPS Output Connection

The output of OL1000TEXL, OL1000EXL-M and OL2000TEXL are socket-types only. Simply plug the load power cord to the output sockets to complete connection.

Model No.	Output Socket (pcs)	Terminal Block
OL1000TEXL	4	Not Available
OL1000EXL-M	4	Not Available
OL2000TEXL	6	Not Available
OL2000EXL-M	4	Available
OL3000TEXL	4	Available
OL3000EXL-M	4	Available

Besides output sockets, the OL2000EXL-M and OL3000TEXL/ OL3000EXL-M units have a terminal block available for output as well. The terminal block can be wired using the following procedure:

1. Remove the terminal block cover.
2. Use AWG14 or 2.1mm^2 wires for wiring configuration.
3. Upon completion of the terminal block wiring, check to ensure the wires are securely fastened.
4. Replace the terminal block cover.

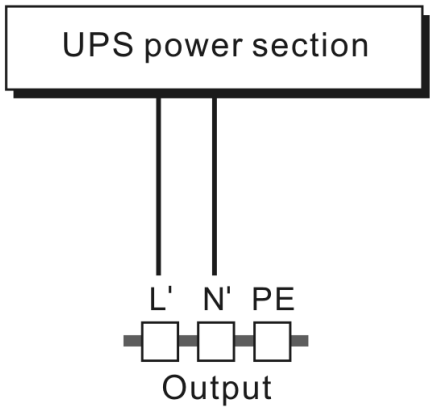

Figure 2: Terminal Blcok Connectiondiagram of OL2000EXL-M and OL3000TEXL/ OL3000EXL-M

5.2.3 Computer Connection:

Connect your computer to the sockets of the UPS system following the above diagram.

Caution!
Do not connect equipment which would overload the UPS system (e.g. laser printers)

5.3 Charge Battery:

Fully charge the batteries of the UPS system by leaving the UPS system connected to the utility power for 1-2 hours. You may use the UPS system directly without charging it but the battery run time may be shorter than the listed run times.

5.4 Power on the UPS:

5.4.1 Utility power present:

Press “Power On” button for more than 1 second to turn on the UPS. The UPS will go into self-test status first. The UPS will go into the inverter mode next. At this time, the AC Input, UPS On, Load Capacity, and Battery Capacity LEDs will light up.

5.4.2 Utility power not present:

Even without the utility power connected to the UPS, the UPS still can be turned on by just simply pressing “Power On” button for more than 1 second. The UPS will go into self-test status first. The UPS will then go into the inverter mode. At this time, Battery, UPS On, Load Capacity, and Battery Capacity LEDs will light up.

5.5 Test Function:

Test the function of the UPS system by either pressing the “Power On” button or disconnecting the input of the UPS system from the power supply.

5.6 Power off the UPS:

5.6.1 In Inverter Mode:

Press “⏻“ button continuously for more than 1 second to turn off the UPS. Then the UPS will enter self-test status. After finishing the self-test, the UPS will enter bypass mode and the AC Input LED and Bypass LED will light up. At this time, the UPS might provide output. Disconnect the utility power to turn off the output.

5.6.2 In Battery Mode:

Press "⏻" button for more than 1 second to turn off the UPS. Then the UPS enter into self-test status. After finishing the self-test, the UPS will be turned off completely.

5.7 Audible Alarm Mute Function:

To disable the alarm in battery mode, you may press "Power On" button for more than 1 second to clear it. However, the alarm will be automatically restored when the battery is low to indicate shutdown is imminent.

5.8 Operation Procedure of External Battery for extended run times ("EXL-M" Models)

The units with CE markings—

(a) Use the battery pack with the following voltages: 36VDC for OL1000TEXL(3 pcs of 12V batteries), 96VDC for OL2000TEXL / OL3000TEXL (8 pcs of 12V batteries). Do not connect any other quantities or voltages of batteries.

(b) One end of the external battery cord is a plug for connecting the UPS and the other end has a plug for connecting the battery cabinet

(c) Do not connect a load to the UPS yet. Connect the power cord of the UPS to the utility supplied power.

(d) Connect the plug of the external battery cord to the external battery socket on the rear panel of the UPS to complete the connection and the UPS will automatically charge the battery pack.

The Caution!
The output sockets of the UPS system may still be electrically charged even if the power supply system has been disconnected or the Bypass switch is in the "OFF" position.

6. Trouble Shooting

If the UPS system does not operate correctly, please attempt to solve the problem using the table below.

Problem	Possible cause	Remedy
No indication, no warning tone even though system is connected to mains power supply	No input voltage	Check building wiring socket and input cable.
AC INPUT LED blinks	Phase and neutral conductor at input of UPS system are reversed	Check the phase and neutral at the building wiring socket..
AC INPUT LED blinks and BATTERY-LED lights up	Input power and/or frequency are out of tolerance	Check the input power source
AC INPUT and BYPASS LED light up even though the power supply is available	Inverter not switched on	Press On-Switch “I”
UPS ON LED lights up, and audible alarm sounds 1 beep every 4 seconds	Mains power supply has failed	Switching to battery mode automatically. When audible alarm sounding every second, battery is almost empty.
FAULT LED lights, warning tone once a second	Overload	Reduce the connected loads.
FAULT-LED lights up, permanent warning tone	UPS fault	Notify dealer!!
Emergency supply period shorter than nominal value	Batteries not fully charged / weak batteries	Charge the batteries for at least 1 - 2 hours and then check capacity. If the problem still persists, consult your dealer.
FAULT LED lights, BATTERY-LED blinks, warning tone once a second	Charger or Batteries may be damaged	Notify dealer!!

Please have the following information at hand before calling the After-Sales Service Department:

1. Model number and serial number
2. Date when the problem occurred
3. Detailed description of the problem

7. Maintenance

7.1 Operation

The UPS system contains no user-serviceable parts. If the battery service life (3 - 5 years at 25°C ambient temperature) has been exceeded, the batteries must be replaced. Please contact your dealer.

7.2 Storage

The batteries should be charged every three months for 1-2 hours to maintain charge. You should shorten the charging intervals to two months at locations subject to high or low temperatures.

8. Technical Data

8.1 Electrical specifications

Model No.	OL1000TEXL/ OL1000EXL-M	OL2000TEXL/ OL2000EXL-M	OL3000TEXL/ OL3000EXL-M
INPUT			
Phase	Single		
Frequency	46 Hz ~54Hz/56 Hz ~64 Hz		
Current(A)	7A	12A	16A
OUTPUT			
Power rating	1kVA/0.7kW	2kVA/1.4kW	3kVA/2.1kW
Voltage	220/230/240×（1 ± 2%）VAC		
Frequency	50 Hz/60 Hz±0.2Hz (Battery mode)		
Wave form	sinusoidal		
BATTERIES(STANDARD)			
Quantity and type	3×12V 7.2Ah	8×12V 7.2Ah	8×12V 7.2Ah

8.2 Operating Environment

Ambient Temperature	0 °C to 40 °C, 0 °F to 104 °F
Operating humidity	< 95%
Altitude	< 1000m, 3281ft
Storage temperature	0 °C to 40 °C, 0 °F to 104 °F

8.3 Typical stored energy time (Typical values at 25°C / 77°F in minutes:)

Model No.	100 % Load	50 % Load
OL1000TEXL	5	14
OL2000TEXL	9	21
OL3000TEXL	5	15

8.4 Dimensions and weights

Model No.	Dimensions W x D x H (mm)	Net Weight (kg)
OL1000TEXL	145X400X220	14
OL1000EXL-M	145X400X220	7
OL2000TEXL	192X460X340	34.5
OL2000EXL-M	192X460X340	15
OL3000TEXL	192X460X340	35.5
OL3000EXL-M	192X460X340	16

9. Product Specification and Performance– OL6000TEXL/OL6000EXL-M/ OL10000TEXL/OL10000EXL-M

9.1 General Specification

Model		OL6000TEXL	OL6000EXL-M	OL10000TEXL	OL10000EXL-M
Power Rating		6KVA/4.2KW	6KVA/4.2KW	10KVA/7KW	10KVA/7KW
Input	Frequency (Hz)	46Hz-54Hz/56Hz-64Hz			
	Voltage	(176-276)VAC			
	Current	31A max.	31A max.	50A max	50A max.
Battery	Voltage	240VDC			
	Current	24A max	24A max	40A max	40A max
Output	Voltage	220/230/240Vac			
	Current	27A	27A	45A	45A
	Frequency (Hz)	50Hz/60Hz±0.2 Hz（Battery Mode）			
Dimension (WxDxH) mm		260x570x717			
Weight (kg)		90	35	93	38

9.2 Electrical Performance

Input			
Model	Voltage	Frequency	Power Factor
OL6000TEXL/ OL6000EXL-M/ OL10000TEXL/ OL10000EXL-M	Single-phase	46Hz-54Hz/ 56Hz-64Hz	>0.98 (Full load)

Output					
Voltage Regulation	Power Factor	Frequency tolerance.	Distortion	Overload capacity	Current crest ratio
±1%	0.7 lag	Synchronized 46-54Hz in Line mode (AC mode) ±0.1% of normal frequency in Battery mode	THD≤4% Full R load THD≤ 8% Full RCD load(Linear Load)	105%-130% load transfers to bypass mode after 10 minutes >130% load transfers to bypass mode after 1 second and shutdown the output after 1 minute	3:1 maximum

9.3 Operating Environment

Temperature	Humidity	Altitude	Storage temperature
0°C-40°C	<95%	<1000m	0°C-40°

Note: *if the UPS is installed or used in a place where the altitude is above than* ***1000m****, the output power must be derated in use, please refer to the following:*

Altitude (M)	1000	1500	2000	2500	3000	3500	4000	4500	5000
Derating Power	100%	95%	91%	86%	82%	78%	74%	70%	67%

10. Installation

10.1 Unpacking and Inspection

10.1.1 Unpack the packaging and check the package contents. The shipping package contains:

- A UPS
- A user manual
- A communication cable
- A battery cable (for EXL-M models only)

10.1.2 Carefully inspect the UPS and look for any damage that may have occurred during transportation. If there is any damage do not turn on the unit and notify the carrier and dealer immediately.

10.2 Input and output power cords and protective earth ground installation

10.2.1 Notes for installation

10.2.1.1 The UPS must be installed in a location with good ventilation, far away from water, flammable gas, and corrosive agents.

10.2.1.2 Ensure the air vents on the front and rear of the UPS are not blocked. Allow at least 0.5m of space on each side.

10.2.1.3 Condensation may occur if the UPS is unpacked in a very low temperature environment. In this case it is necessary to wait until the UPS is fully acclimated before installing and using. Failure to do so may create a risk of electric shock.

10.2.2 Installation

Installation and wiring must be performed in accordance with the local electric code and by a licensed electrician.

For safety, please shut off the mains power switch before installation. If it is a extended backup time model (“EXL-M” model), the battery breaker also needs to be shut off if.

10.2.2.1 Open the terminal block cover located on the rear panel of the

UPS, please refer to the appearance diagram.

10.2.2.2 For OL6000TEXL/OL6000EXL-M UPS, it is recommended to select the UL1015 10AWG(6mm^2) wire or other insulated wire which complies with AWG Standard for the UPS input and output wirings.

10.2.2.3 For OL10000TEXL/OL10000EXL-M, it is recommended to select the UL1015 8AWG(10mm^2) wire or other insulated wire which complies with AWG Standard for the UPS input and output wirings.

Note: *Do not use the wall receptacle as the input power source for the UPS, as its rated current is less than the UPS's maximum input current. Otherwise the receptacle may be destroyed.*

10.2.2.4 Connect the input and output wires to the corresponding input and output terminals according to the following diagram.

Note: *you must make sure that the input and output wires and the input and output terminals are connected tightly.*

10.2.2.5 The protective earth ground wire refers to the wire connection between the equipment which consumes electric power and the ground wire. The wire diameter of protective earth ground wire should be at least the specs described above for each model and green wire or green wire with a yellow stripe.

10.2.2.6 After completing the installation, make sure the wiring is correct.

10.2.2.7 Please install the leak current protective breaker at the output power distribution panel of the UPS if necessary.

10.2.2.8 To connect the load with the UPS, please turn off all the loads first, then perform the connection and finally turn on the loads one by one.

10.2.2.9 No matter if the UPS is connected to the utility power or not, the output of the UPS may be electrically charged. The parts inside the unit may still have hazardous voltage after turning off the UPS. To make the UPS has no output, power off the UPS, and disconnect the utility power supply.

10.2.2.10 It is strongly suggested to charge the batteries for 8 hours before use. After connection, turn the input breaker in the "ON" position, the UPS will charge the batteries automatically. You can also use the UPS immediately without charging the batteries, but the backup time may be

less than optimum.

10.2.2.11 If it is necessary to connect an inductive load such as a monitor or a laser printer to the UPS, the start-up power should be used for calculating the capacity of the UPS, as its start-up power consumption is too large when it is started.

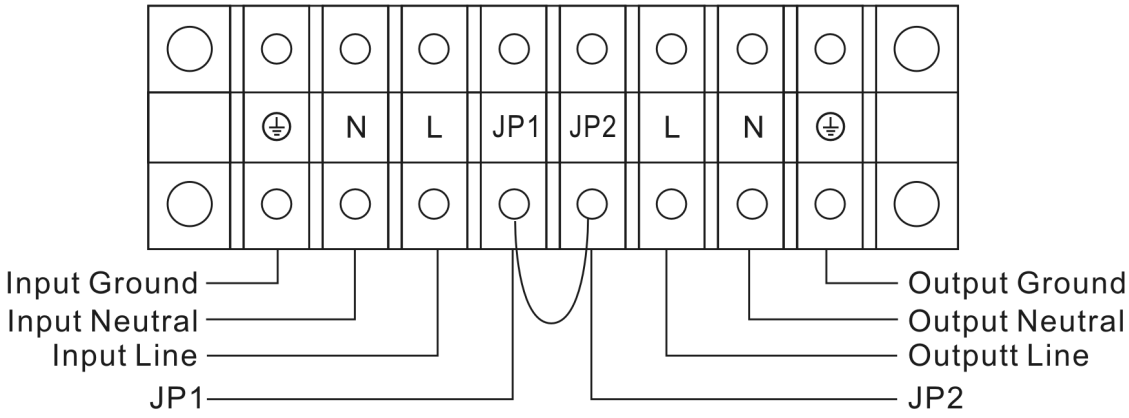

Input and output Terminal Block wiring diagram of OL6000TEXL/OL6000EXL-M/OL10000TEXL/OL10000EXL-M

Important notes: If the UPS is used in single mode, JPI and JP2 must be connected by 10AWG(6mm2). If the UPS is used in parallel mode, the Jumper between JP1 and JP2 must be removed.

10.3 Operating procedure for connecting the long backup time model UPS with the external battery

10.3.1 The nominal DC voltage of external battery pack is 240VDC. Each battery pack consists of 20 pieces of 12V maintenance free batteries in series. To achieve longer backup time, it is possible to connect multi-battery packs, but the principle of “same voltage, same type” should be strictly followed.

10.3.2 The connector of the external battery cable is used to plug into the external battery socket of the UPS, the other end of the external battery cable is made of three open wires with ring terminals to connect with the external battery pack(s). The procedure of installing battery bank should be complied with strictly. Otherwise you may encounter the hazardous of electric shock.

10.3.2.1 A DC breaker must be connected between the battery pack and the UPS. The capacity of breaker must be not less than the data specified in the general specification.

10.3.2.2 Set the battery pack breaker in “OFF” position and connect the 20 pieces of batteries in series.

10.3.2.3 You must connect the external battery cable to the battery first, if you connect the cable to the UPS first, you may encounter the hazardous of electric shock. The positive pole of the battery is connected to the OL10000EXL-M in parallel with blue and brown wires; the negative pole of the battery is connected to the OL10000EXL-M in parallel with black and white wires; the green and yellow ribbon wire is connected to the ground of the battery cabinet.

10.3.3 To complete the connection by plugging the connector of the external battery cable into the external battery socket of the UPS. Do not attempt to connect any loads to the UPS now. You should connect the input power wire to the right position first. And then set the breaker of the battery pack in the ON position. After that set the input breaker in the ON position. The UPS begins to charge the battery packs at the time.

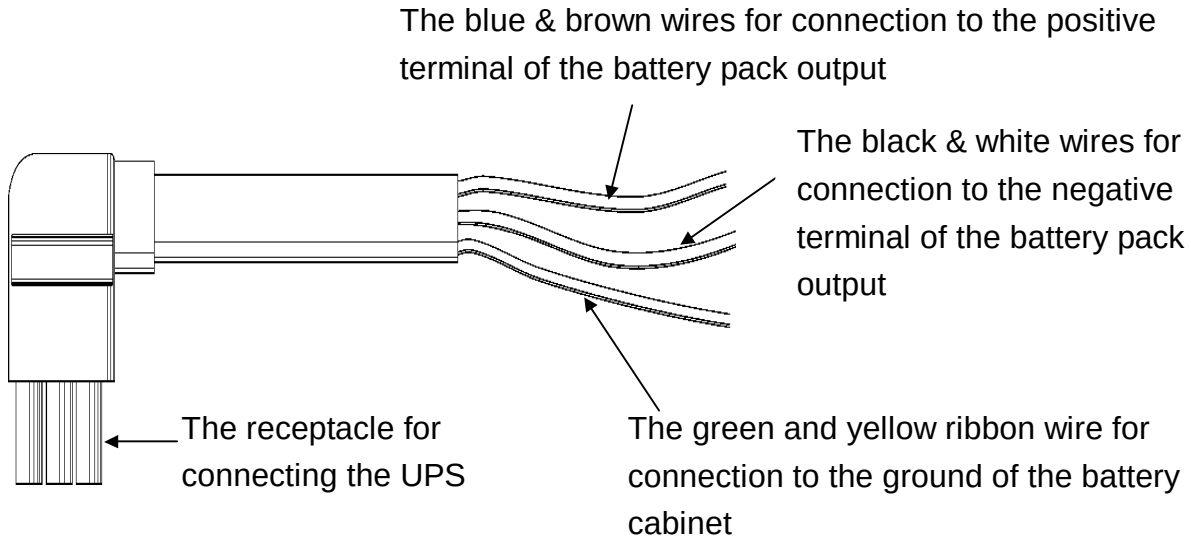
The blue & brown wires for connection to the positive terminal of the battery pack output
The black & white wires for connection to the negative terminal of the battery pack output
The receptacle for connecting the UPS
The green and yellow ribbon wire for connection to the ground of the battery cabinet

10.4 Parallel operation

10.4.1 Brief introduction of the redundancy

N+X is currently the most reliable power supply structure. N represents the minimum UPS number that the total load needs; X represents the redundant UPS number, i.e. the fault UPS number that the system can handle simultaneously. The bigger the X is, the higher reliability of the power system is. For occasions where reliability is highly depended on, N+X is the optimal mode.

As long as the UPS is equipped with parallel cables, up to 3 UPSs can be connected in parallel to realize output power sharing and power redundancy.

10.4.2 Parallel installation

10.4.2.1 Users need to opt a standard 25-pin communication cable, which should have 25 cores, corresponding stitches and shield, as the UPS parallel cable. The length of the parallel cable is appropriate to be less than 3 m.

10.4.2.2 Strictly follow the stand-alone wiring requirement to perform the input wiring of each UPS.

10.4.2.3 Connect the output wires of each UPS to an output breaker panel.

10.4.2.4 Disconnect the Jumper on JP1 and JP2 of the terminal block first, and connect each output breaker to a main output breaker and then to the loads.

■ **The requirement of the output wiring is as follows:**

- When the distance between the UPSs in parallel and the breaker panel is less than 20 meters, the difference between the wires of input & output of the UPSs is required to be less than 20%.
- When the distance between the UPSs in parallel and the breaker panel is greater than 20 meters, the difference between the wires of input & output of the UPSs is required to be less than 10%.

11. Operation and maintenance

11.1 To perform the general operation, follow the stand-alone operating requirement.

11.2 Startup: The units transfer to INV mode simultaneously as they start up sequentially in utility power mode.

Shutdown: the units shut down sequentially in INV mode. When the last one completes the shutdown action, each unit will shut down the inverter simultaneously and transfer to bypass mode.

It is easy to operate the equipment, with no previous training. You just need to read through this manual and operate according to the instructions in it. The meaning of the LED indicators, please refer to the appendix 1 “Display panel”

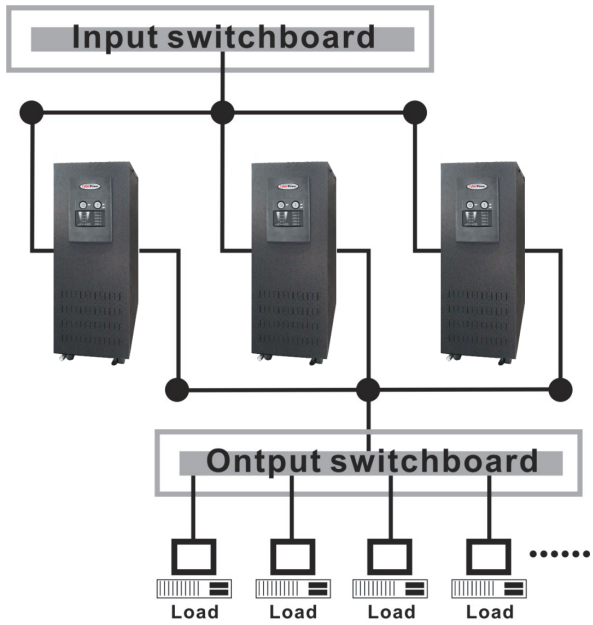

Parallel Installation Diagram

11.3 Operation

11.3.1 Turn on the UPS with utility power supplied (in Line mode/AC mode)

11.3.1.1 After you make sure that the power supply connection is correct, set the bypass breaker and the input breaker in the “ON” position first. At this time the fan rotates and the UPS supplies power to the load via the bypass. The UPS operates in Bypass mode.

11.3.1.2 To power on the UPS by simply pressing the “ON” button continuously for more than 1 second.

11.3.1.3 When being powered on, the UPS will perform self-diagnosis, with the load/battery level LEDs turned on and then off one after another in ascending order. A few seconds later, the INV LED is turned on, the UPS is already running in Utility Power mode. If the utility power

is abnormal, the UPS will operate in battery mode without output interruption of the UPS.

11.3.2 Turn on the UPS with no utility power supplied (in Battery mode)

11.3.2.1 Press the “ON” button continuously for more than 1 second to power on the UPS.

11.3.2.2 For long back up time model (“EXL-M” model), please make sure that the battery breaker is in “ON” position.

11.3.2.3 During the course of starting up, the UPS has the same action as if it is connected to utility power except that the ac input LED is not turned on and the battery LED is turned on instead.

11.3.3 Turn off the UPS with utility power supplied (in Line mode/AC mode)

11.3.3.1 Press the “OFF” button continuously for more than 1 second to turn off the inverter of the UPS immediately.

11.3.3.2 When being powered off, the UPS will perform self-diagnosis, the Load/Battery level LEDs will be turned on and then off one after another in ascending order, then the INV LED will be turned off and Bypass LED will be turned on. The UPS is working in Bypass mode.

11.3.3.3 Upon completion of the above to turn it off, output of electric current of the UPS is still present. In order to cut off the output from the UPS, simply cut off the utility power supply and the UPS will perform self-diagnosis, finally not any display is shown on the display panel and no voltage output is available from the UPS output.

11.3.4 Turn off the UPS with no utility power supplied (in Battery mode)

11.3.4.1 Press the “OFF” button continuously for more than 1 second to power off the UPS.

11.3.4.2 When being powered off, the UPS will perform self-diagnosis, the Load/Battery level LEDs will be turned on and then off one after another in ascending order. Finally not any display is shown on the display panel and no voltage is available from the UPS output.

Suggestions: *Please turn off the connected loads before turning on*

the UPS and turn on the loads one by one after the UPS is working in INV mode. Turn off all of the connected loads before turning off the UPS.

11.3.5 Parallel Machine Maintenance

This UPS system has parallel machine function, if you want to add single machine to parallel system, please follow operational process of joining new machine; if because of cutting down load or attainting UPS, and you must remove UPS, please follow operational processes of removing parallel machine.

11.3.5.1 Join new UPS process:

11.3.5.1.1 Before joining new UPS, user should prepare input & output line, switch and combine line.

11.3.5.1.2 New UPS input & output switch should be turned off, according to port sign, link Input & output line and batteries; synchronously, remove the connection between JP1 and JP2.

11.3.5.1.3 Turn off UPS system, when all UPS work at bypass model, please take apart every UPS repaired board, turn all UPS repaired switches from ‘UPS’ to ‘BPS’ and then turn off all UPS input switch.

11.3.5.1.4 If UPS system works at single UPS model, then have to remove the connection of JP1 and JP2.

11.3.5.1.5 Take apart the board of parallel ports, insert one end of combine line into parallel card’s slot and screw down its pin; and then lock up the board of parallel ports over again; at the same time, take apart the maintain board of new UPS.

11.3.5.1.6 Turn on the battery switch of new UPS and line input connection switch outside; measure voltage difference between output live wire of new UPS and output live wire of parallel system. If the voltage difference＜1V, please close output live wire’s witch of new UPS.

11.3.5.1.7 Take apart the board of parallel ports when UPS has turned to bypass mode, insert the other end of combine line into parallel card’s slot and screw down its pin; and then lock up the board of parallel ports over again

11.3.5.1.8 Close line input switch of all UPS(include new UPS) in the parallel system; lock up maintain board, unless all UPS turn to bypass mode; press the open key in turn, observe whether the display state of every UPS is normal; at the same time, observe whether all UPS all together turn to inverter model; and measure the voltage difference of every UPS ports' JP2.

11.3.5.1.9 Turn off all UPS, take apart maintain board of all UPS unless they all have turned to bypass mode. Turn all the maintain switches from "BPS" to "UPS" and lock up every maintain board.

11.3.5.1.10 Turn on UPS, make all UPS changed into line inverter mode to work parallel.

Note: *If the state of UPS is abnormal in step 8, please follow operational process of removing single UPS to maintain.*

11.3.5.2 Operational process of removing single UPS:

11.3.5.2.1 If want to remove UPS which is running normally, please press the close key of the removing one continuously for 2 times

11.3.5.2.2 Shut off the UPSs own line switch, line output switch outside and battery switch, when this UPS need to remove out.

11.3.5.2.3 Turn off other UPS which are running, take apart the maintain cover of every UPS and turn all UPS maintain switch from "UPS" to "BPS" until all running UPS turn to BPS mode. Then turn off every UPS own input switch.

11.3.5.2.4 After removing single UPS, if leaving UPS system is changed to single running, please connect the short line between JP1 and JP2 of this UPS output port.

11.3.5.2.5 Take apart another UPS parallel cover and combine line connected with the UPS which need to remove until all UPS panels become black, then lock up the cover of parallel ports again.

11.3.5.2.6 Take apart UPS parallel cover and combine line when the UPS have to remove, then lock up the cover of parallel ports again.

11.3.5.2.7 Shut input line switch of leaving UPS system, turn maintain switch from "BPS" to "UPS" until all UPS turn to BPS mode and lock up the maintain cover, then turn on the machine and turn all UPS to line inverter mode running.

11.3.5.3 Combine machine warning:

11.3.5.3.1 When UPS combine system work at inverter mode, make sure that all UPS maintain switches at the same place, that is to say, be at the position of “UPS”, or be at the position of “BPS”.

11.3.5.3.2 When turning on the UPS combine system before enter into inverter mode, UPS output switch must at “OFF” model.

11.3.5.3.3 When UPS combine system work at inverter model, please do not operate any UPS maintain switch.

11.3.6 Backup time for the standard model

The backup time of the long backup time model is dependent on the external battery pack capacity and the load level as well as other factors.

The backup time of standard model may vary from different models and load level. Please refer to the following:

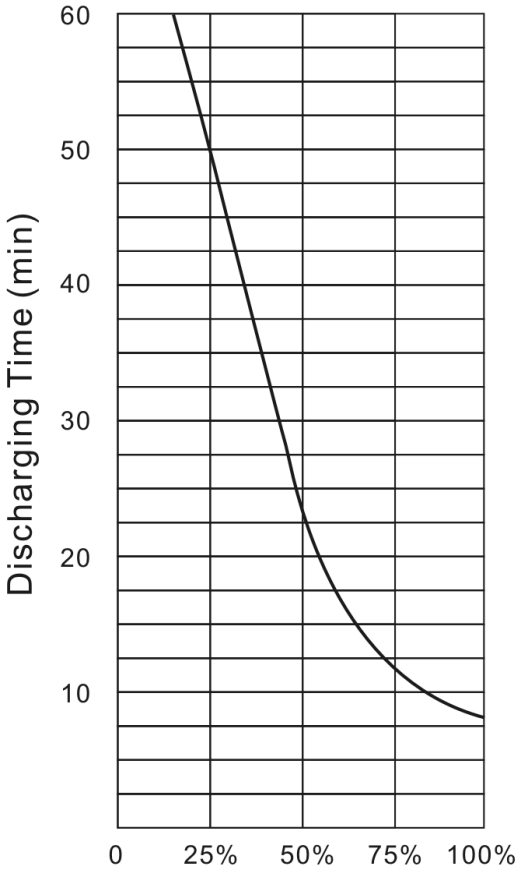

Load level

backup time of 6kVA

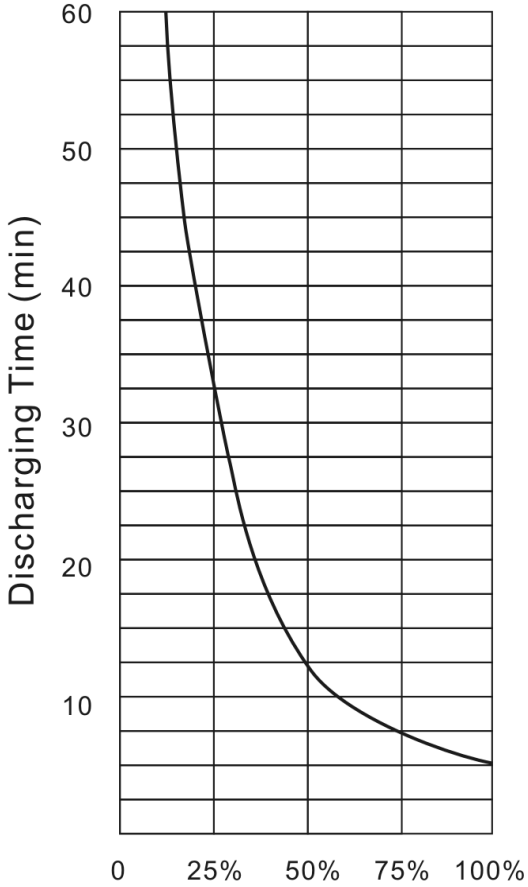

Load level

backup time of 10kVA

12. Battery Maintenance

- This series UPS only requires minimal maintenance. The battery used for standard models are value regulated sealed lead-acid maintenance free battery. These models require minimal repairs. The only requirement is to charge the UPS regularly in order to maximize the expected life of the battery. When being connected to the utility power, whether the UPS is turned on or not, the UPS keeps charging the batteries and also offers the protective function of overcharging and over-discharging.
- The UPS should be charged once every 4 to 6 months if it has not been used for a long time.
- In the regions of hot climates, the battery should be charged and discharged every 2 months. The standard charging time should be at least 12 hours.
- Under normal conditions, the battery life lasts 3 to 5 years. In case if the battery is found not in good condition, earlier replacement should be made. Battery replacement should be performed by qualified personnel.
- Replace batteries with the same number and same type of batteries.
- Do not replace the battery individually. All the batteries should be replaced at the same time following the instructions of the battery supplier.
- Normally, the batteries should be charged and discharged once every 4 to 6 months. Charging should begin after the UPS shuts down automatically in the course of discharging, the standard charging time for the standard UPS should be at least 12 hours.

13. Notes for Battery Disposal and Battery Replacement

1) Before disposing of batteries, remove conductive jewelry such as necklace, wrist watches and rings.

2) If it is necessary to replace any connection cables, please purchase the original materials from the authorized distributors or service centers, so as to avoid overheat or spark resulting in fire due to insufficient capacity.

3) Do not dispose of batteries or battery packs in a fire, they may explode.

4) Do not open or mutilate batteries, released electrolyte is highly poisonous and harmful to the skin and eyes.

5) Do not short the positive and negative of the battery electrode, otherwise, it may result in electric shock or fire.

6) Make sure that there is no voltage before touching the batteries. The battery circuit is not isolated from the input potential circuit. There may be hazardous voltage between the battery terminals and the ground.

7) Even though the input breaker is disconnected, the components inside the UPS are still connected with the batteries, and there are potential hazardous voltages. Therefore, before any maintenance and repairs work is carried out, switch off the breaker of the battery pack or disconnect the jumper wire of connecting between the batteries.

8) Batteries contain hazardous voltage and current. Battery maintenance such as the battery replacement must be carried out by qualified personnel who are knowledgeable about batteries. No other persons should handle the batteries.

14. Trouble Shooting

Problem	Possible cause	Solution
The #1 Fault LED and the #6 LED are turned on, the buzzer beeps continuously.	The UPS transfers to fault mode due to internal overheat.	Make sure the UPS is not overloaded; the air vents are not blocked and the ambient temperature is not too high. Wait for 10 minutes for the UPS to cool down before turning on again. If failed, please contact the distributor or service center.
The #1 Fault LED and the #2 and #5 LED are turned on, and the buzzer beeps continuously.	The UPS output is short circuited.	Remove all the loads. Turn off the UPS. Ensure that the load is not failed or the UPS has no internal faults before turning it on again. If failed, please contact the distributor or service center.
The #1 Fault LED and the #4 LED are turned on, the UPS beeps continuously.	The UPS transfers to fault mode due to its internal fault.	Please contact the distributor or service center.
The #1 Fault LED and the #5 LED are turned on, the UPS beeps continuously.	The UPS transfers to fault mode due to its internal fault.	Please contact the distributor or service center.
The ac input LED flashes.	The voltage or frequency of the utility power is out of the input range of the UPS.	The UPS is running in battery mode. To save your data and close the application program. Make sure the utility power is within the input voltage or frequency range permitted by the UPS.
The #1 Fault LED and the #2 LED are turned on, the UPS beeps continuously.	The UPS is overloaded or the load equipment is faulty.	Check the loads and remove all no-critical equipment. Recalculate the load power and reduce the number of loads connected to the UPS. Check that the loads are not failed.

The #1 Fault LED is turned on, and the battery LED is flashed, the buzzer beeps every second.	The charger of the UPS is defective.	Please contact the distributor or service center.
Battery LED flashes	Battery low or battery not connected.	Check the battery. If the battery is damaged, replace the battery immediately and ensure that the battery breaker is in “ON” position.
The utility power is normal, but the UPS can not turn in line mode	Maintain switch loose	Please contact the distributor or service center.
Battery discharging time diminishes	Battery not yet been fully charged.	Keep UPS connected to utility power persistently for more than 10 hours to recharge the batteries again.
	UPS overloaded.	Check the loads and remove the non-critical equipment.
	Battery aged.	Replace the batteries. Please contact the distributor to obtain the parts and replacement service.
The UPS cannot power on after pressing the ON button	The “ON” button is pressed too briefly.	Press the “ON” button for more than 1 second.
	The UPS is not connected to the battery or the battery pack voltage is too low.	Check the battery or recharge the battery.
	UPS fault.	Please contact the distributor or service center.

When you contact the service center, please provide the following information:

- Model No. and the serial No. of the UPS.
- The date when the problem arose.
- Complete description of the problem, including the LED display, alarm warning, and power condition and load capacity. If your UPS is a long backup time model, you may also provide the battery information.

15. Operating mode for all models

1. Utility power mode

The display panel in utility power mode is shown in the following diagram. The ac input LED and the INV LED are turned on. The load level LEDs will be turned on in accordance with the load capacity connected.

1) If the battery LED is turned on and the ac input LED flashes, it indicates the voltage or frequency of the utility power has exceeded the normal range, the UPS operates in battery mode.

2) If output overloaded, the load level LEDs will be turned on and alarm will keep twice every second. You should get rid of some unnecessary loads one by one to decrease the loads connected to the UPS less than 90% of its nominal power capacity.

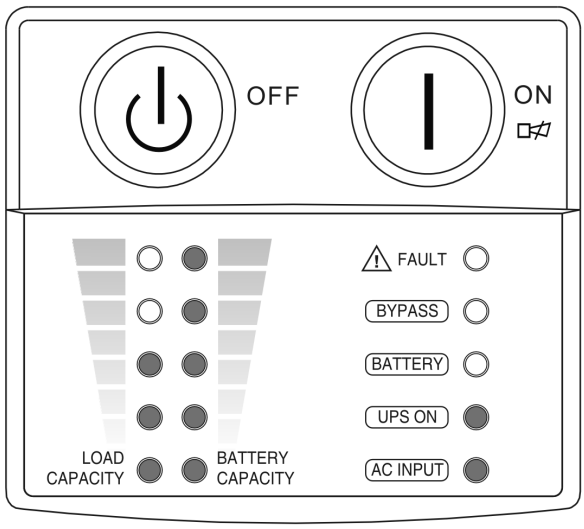

Fig 15.1 The utility power mode

Note: Please follow the following steps to connect the generator：

- Activate the generator and wait until the operation is stable before supplying power of the generator to the UPS (be sure that the UPS is in idle mode). Then turn on the UPS according to the start-up procedure. After the UPS is turned on, then the loads can be connected to the UPS one by one.
- The power capacity of the AC generator should be at least twice of the UPS capacity.

2. Battery mode

The display panel in battery mode is shown in the following diagram Fig.15.2. The battery LED and the INV LED are turned on. The displayed number of the battery level LEDs will be turned on in accordance with the

battery capacity. Note that the load level LEDs in utility power mode will indicate the level of the battery capacity in battery mode instead.

1) When the UPS is running in battery mode, the buzzer beeps once every 4 seconds. If the “ON” button on the front panel is pressed for more than 1 second again, the buzzer will stop beeping (in silence mode). Press the “ON” button once again for more than 1 second to resume the alarm function.

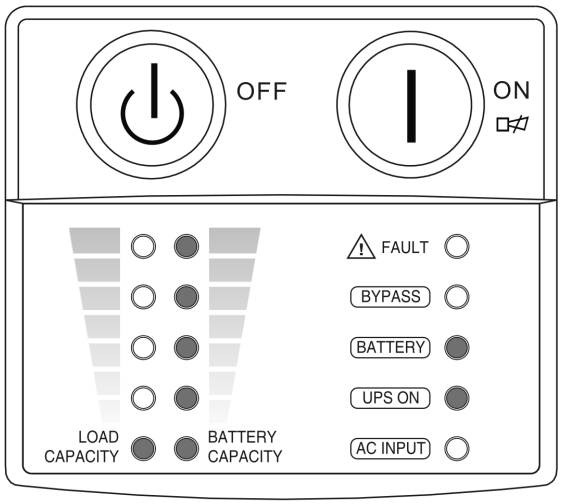

Fig 15.2 Battery mode diagram

2) When the battery capacity decreases, the number of the battery capacity LEDs turned on will be reduced. If the battery voltage descends to the alarm level, the buzzer will beep once every second to remind the users of insufficient battery capacity and the UPS is soon going to shut down automatically. Then the load operations should be carried out promptly and the loads should be eliminated one by one.

3. Bypass mode

The display panel in bypass mode is shown in the following diagram Fig 15.3. The ac input LED and the bypass LED are lit. The displayed number of the load LEDs will be turned on in accordance with the load capacity connected. The UPS will beep once every 2 minutes in bypass mode.

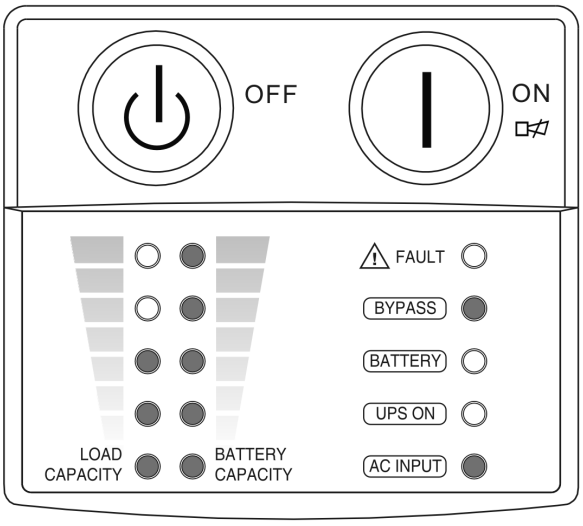

Fig 15.3 UPS bypass mode diagram

The ac input LED flashes, it shows that the voltage or frequency of the utility power has exceeded the normal range of the UPS.

1) Other indications on the display panel are the same in utility mode.

2) The UPS does not have the backup function when it is in bypass mode. The power used by the load is supplied from the utility power via internal filter.

4. Abnormality mode

In case the fault LED is turned on when the UPS is in use, it shows that the UPS is operating in abnormal mode.

16. Communication Port

16.1 RS232 Interface

The following is the pin assignment and description of DB-9 connector.

Pin #	Description	I/O
2	TXD	Output
3	RXD	Input
5	GND	Input

16.2 Serial to USB Adapter (Option)

Optional Serial to USB Adapter cable allows flexible application in UPS.

Fig 16.2 Serial to USB Adapter

16.3 AS400 Interface(Option)

Except for the communication protocol as mentioned above, this series UPS has AS400 card (an optional accessory) for AS400 communication protocol. Please contact your local distributor for details. The following is the pin assignment and description of DB-9 connector in AS400 card.

Pin #	Description	I/O
1	UPS Fail	Output
2	Summary Alarm	Output
3	GND	Input
4	Remote Shutdown	Input
5	Common	Input
6	Bypass	Output
7	Battery Low	Output
8	UPS ON	Output
9	Line Loss	Output

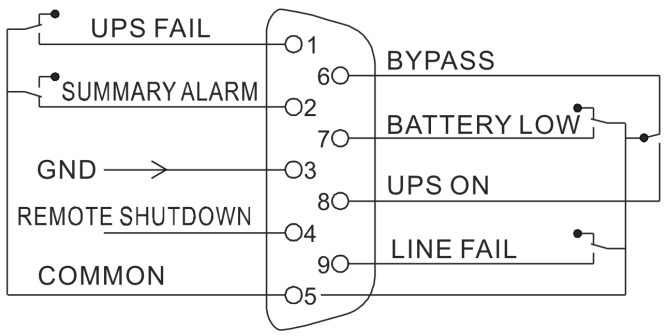

Figure 16.3: DB-9 Interface of AS400 communication protocol

17. Software for all models

Software CD — PowerPanel® Business Edition

PowerPanel® Business Edition is a brand new UPS monitoring software, which provides user-friendly interface to monitor and control your UPS. This unique software provides safely auto shutdown for computer systems while power failure.

Regarding the detail descriptions of PowerPanel® Business Edition software you can see the accessory and software installation guide.

Appendix 1-Display Panel (for OL6000TEXL /OL6000EXL-M/OL10000TEXL/ OL10000EXL-M)

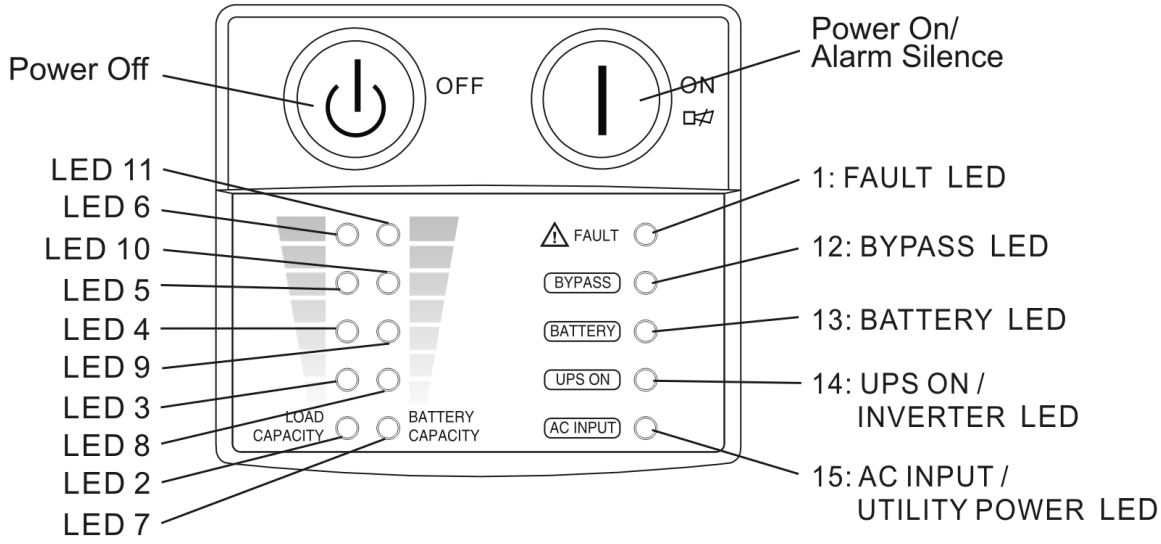

- Power ON/OFF: To turn on the UPS simply by pressing the "ON" button on the front panel continuously for 1 second. Press the "OFF" button on the front panel continuously for 1 second to turn off the UPS.
- Bypass LED (orange LED): Whenever the bypass LED is turned on, it shows that the loading current is supplied directly from the utility power.
- AC input LED (green LED): Whenever the ac input LED is turned on, it shows that the utility power is normal.
- UPS ON LED (green LED): Whenever the UPS ON LED is turned on, it shows that the loading current is supplied from utility power or battery via the inverter.
- Battery LED (green LED): Whenever the battery LED is turned on, it shows that the loading current is supplied from battery via the inverter.
- Fault LED (red LED): Whenever the fault LED is turned on, it shows that the UPS is in abnormal condition.
- #2-#6 LEDs (the #6 LED is orange and the #2-#3 LEDs are green): These LEDs indicate the percentage of the load capacity in any mode except Fault mode.
- #7-#11 LEDs (the #7 LED is orange and the #8-#11 LEDs are green): These LEDs indicate the percentage of the battery capacity in any mode except Fault mode.

Appendix 2-The Corresponding Form of the LED Display for OL6000TEXL / OL6000EXL -M /OL10000TEXL/ OL10000EXL-M

No.	Operating state		LED display															Alarm warning
			1#	2#	3#	4#	5#	6#	7#	8#	9#	10#	11#	12#	13#	14#	15#	
1	Utility Power Mode	0~35% Load capacity		●					↑	↑	↑	↑	↑			●	●	none
2		36%~55% Load capacity		●	●				↑	↑	↑	↑	↑			●	●	none
3		56%~75% Load capacity		●	●	●			↑	↑	↑	↑	↑			●	●	none
4		76%~95% Load capacity		●	●	●	●		↑	↑	↑	↑	↑			●	●	none
5		96%~105% Load capacity		●	●	●	●	●	↑	↑	↑	↑	↑			●	●	none
6	Battery Mode	0~20% Battery capacity		↑	↑	↑	↑	↑	●						●	●		Beep once every sec
7		21%~40% Battery capacity		↑	↑	↑	↑	↑	●	●					●	●		Beep once every 4 sec
8		41%~60% Battery capacity		↑	↑	↑	↑	↑	●	●	●				●	●		Beep once every 4 sec
9		61%~80% Battery capacity		↑	↑	↑	↑	↑	●	●	●	●			●	●		Beep once every 4 sec
10		81%~100% Battery capacity		↑	↑	↑	↑	↑	●	●	●	●	●		●	●		Beep once every 4 sec
11	Bypass mode			●	↑	↑	↑	↑	↑	↑	↑	↑	↑	●			●	Beep once every 2 min.
12	overloaded in utility mode and UPS still in INV mode		●	●	●	●	●	●								●	●	Beep twice every sec.

13	overloaded in utility mode and UPS in bypass mode	●	●	●	●	●	●						●			●	Beep twice every sec.
14	Utility power abnormal		●	↑	↑	↑	↑						↑	↑	↑	★	↑
15	Overloaded in battery mode, Early-warning		↑	↑	↑	↑	●							●	●	↑	Beep twice every sec.
16	Overloaded in battery mode, Cut off the output	●					●									↑	Continuou sly beep
17	Over temperature	●	●										↑			↑	Continuou sly beep
18	Inv abnormal	●		●									↑			↑	Continuou sly beep
19	Output short circuited	●		●			●									↑	Continuou sly beep
20	BUS voltage abnormal	●			●								↑			↑	Continuou sly beep
21	Charger and battery failed	●											↑	★	↑	↑	Beep once every sec
22	BAT SCR failed	●	●			●							↑			↑	Continuou sly beep
23	Fan abnormal	●	●				●						↑	↑	↑	↑	Beep once every sec
24	INV RLY failed	●	●		●								↑			↑	Continuou sly beep
25	Communication abnormal	●			●	●							↑			↑	Continuou sly beep
26	Parallel abnormal	●	●			●	●									↑	Continuou sly beep

● : Solid ON

★ : Flash

↑ : LED display and alarm warning are dependent on other conditions.

Appendix 3—Back Panel

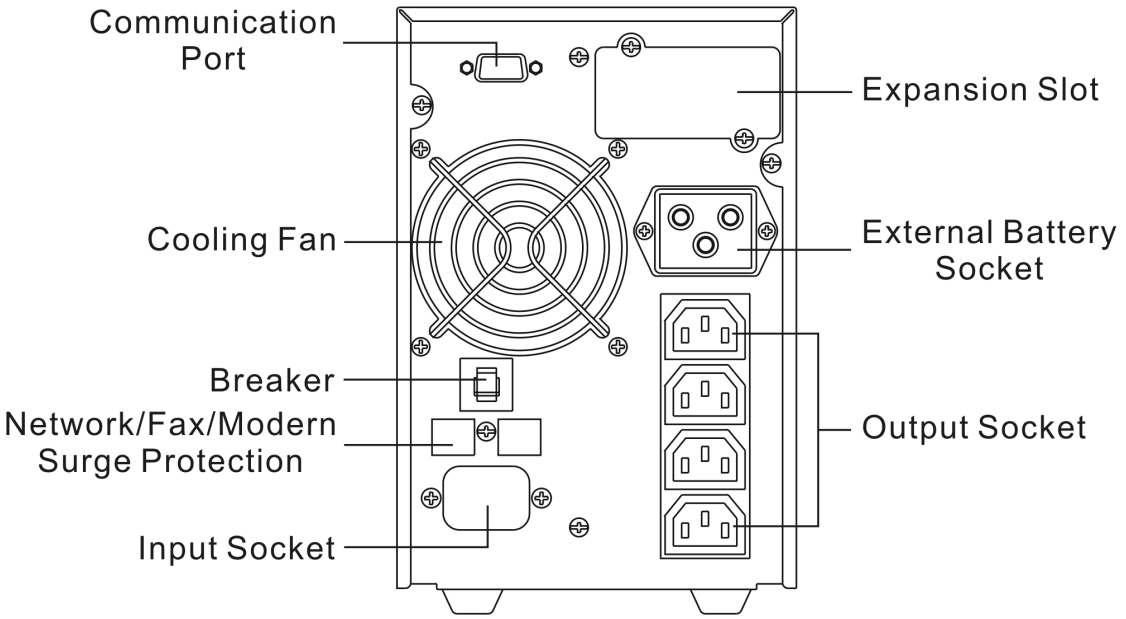

Back View of OL1000TEXL/OL1000EXL-M

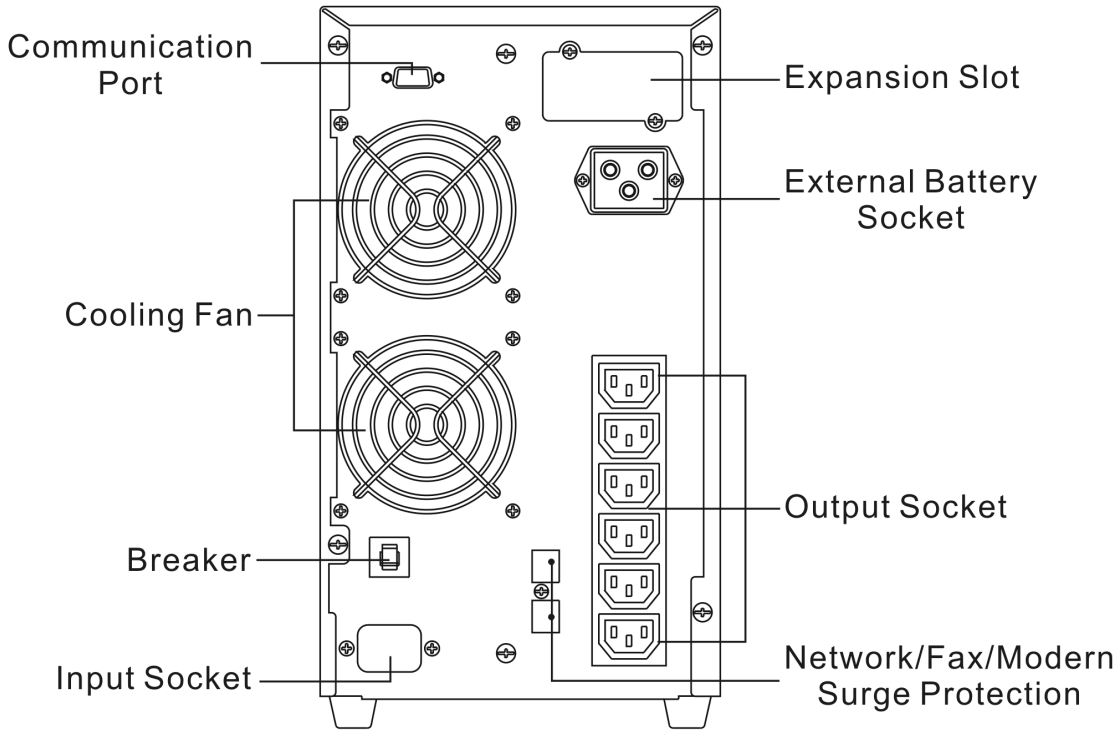

Back View of OL2000TEXL

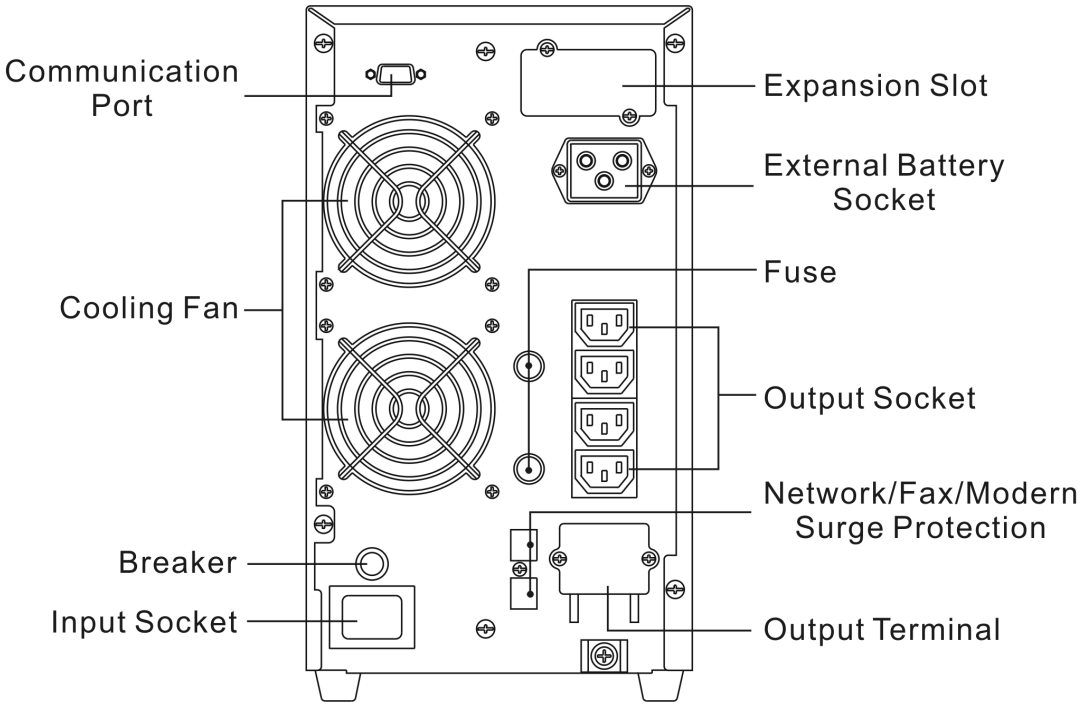

Back View of OL2000 EXL-M/OL3000TEXL/OL3000EXL-M

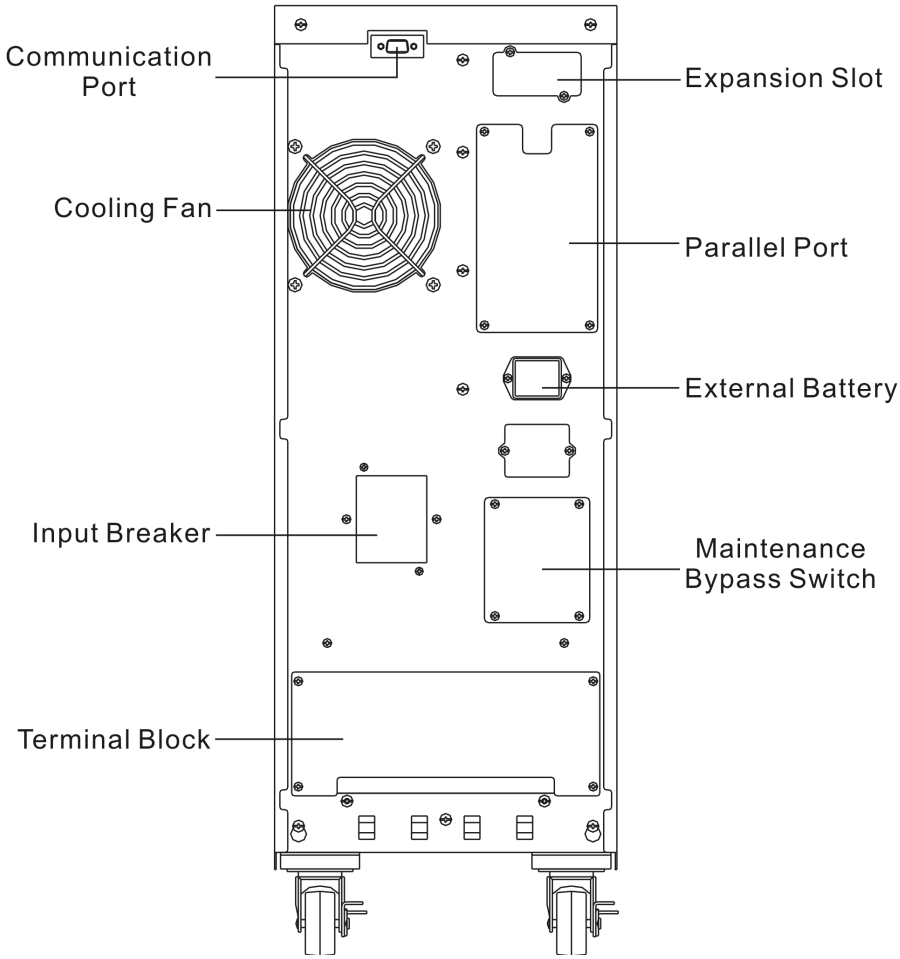

Back View of OL6000TEXL/OL6000EXL-M

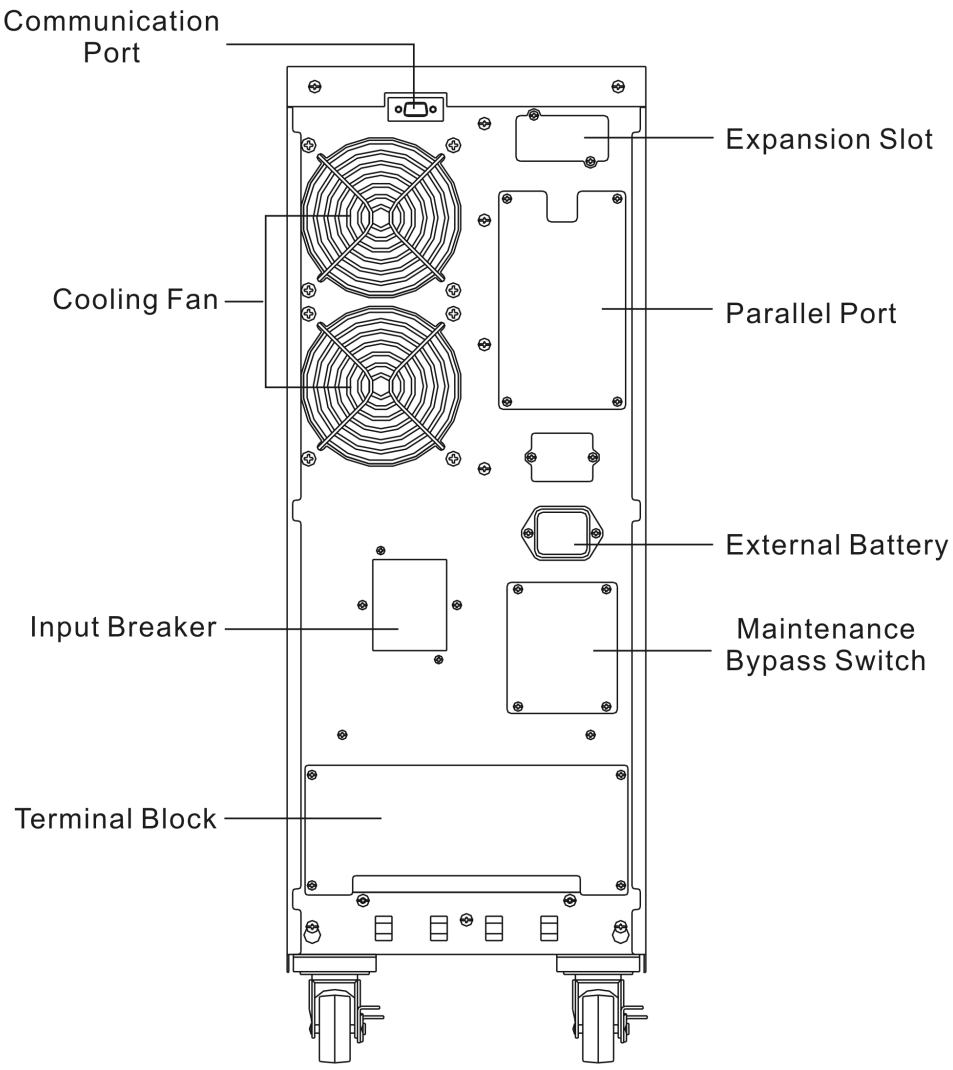

Back View of Back View of OL10000TEXL/OL10000EXL-M

Pb
Pb-Free